
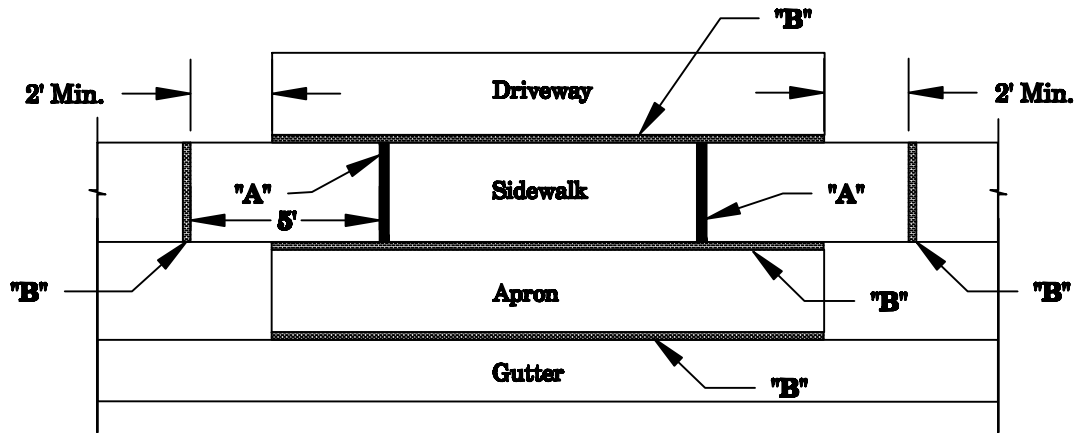
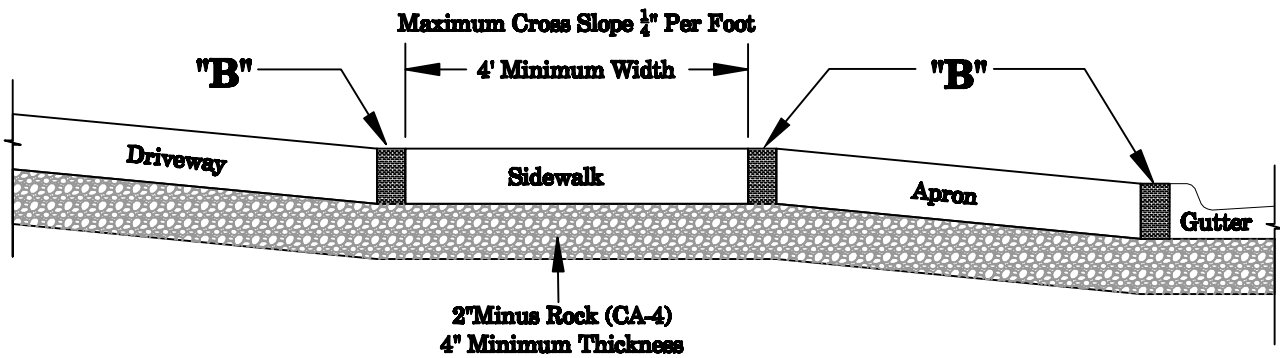


Figure A-11

Residential Sidewalk And Driveway Entrances

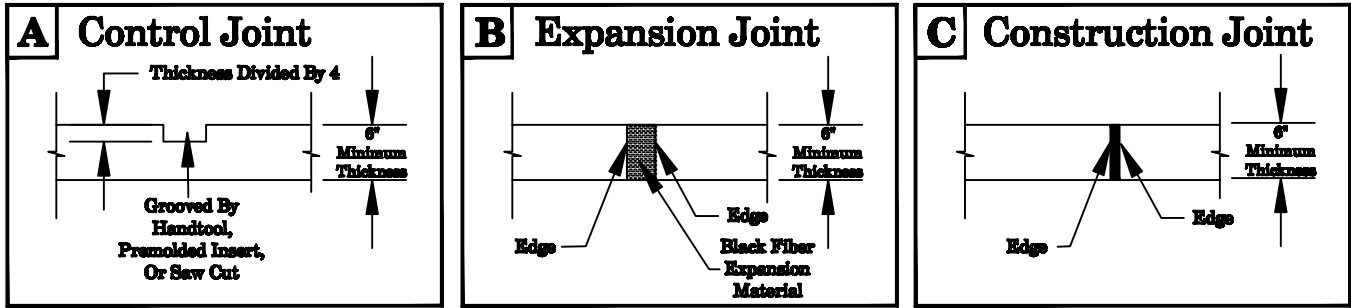

NOTES:

1. Expansion Joint Must Totally Isolate Adjacent Concrete.
2. Additional Expansion Joints Must be Placed Every 25 Feet.
3. Sub-Base Must Be Compacted to 95% Of The Standard Laboratory Density.
4. ADA Handicapped Ramps Must Be Installed at Intersections With An Expansion Separating The Ramp From The Gutter.